


Appendix C

Demand Maps

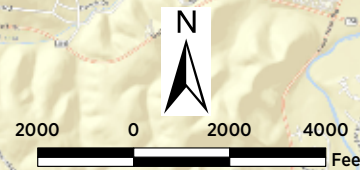

Legend
Existing Max. Day Demand
Gallons per Day (gpd)

[Green]	< 50
[Light Green]	50 - 100
[Lighter Green]	101 - 500
[Yellow-Green]	501 - 1,000
[Yellow]	1,001 - 2,500
[Light Yellow]	2,501 - 5,000
[Yellow-Orange]	5,001 - 10,000
[Orange]	10,001 - 25,000
[Light Orange]	25,001 - 50,000
[Orange]	50,001 - 75,000
[Dark Orange]	75,001 - 100,000
[Red-Orange]	100,001 - 200,000
[Red]	200,001 - 300,000
[Dark Red]	300,001 - 400,000
[Dark Red]	400,001 - 500,000
[Dark Red]	500,001 - 516,022 (Max.)

Water Line


Pump Stations

Clear Well


Reservoir

Water Tank

Parcels

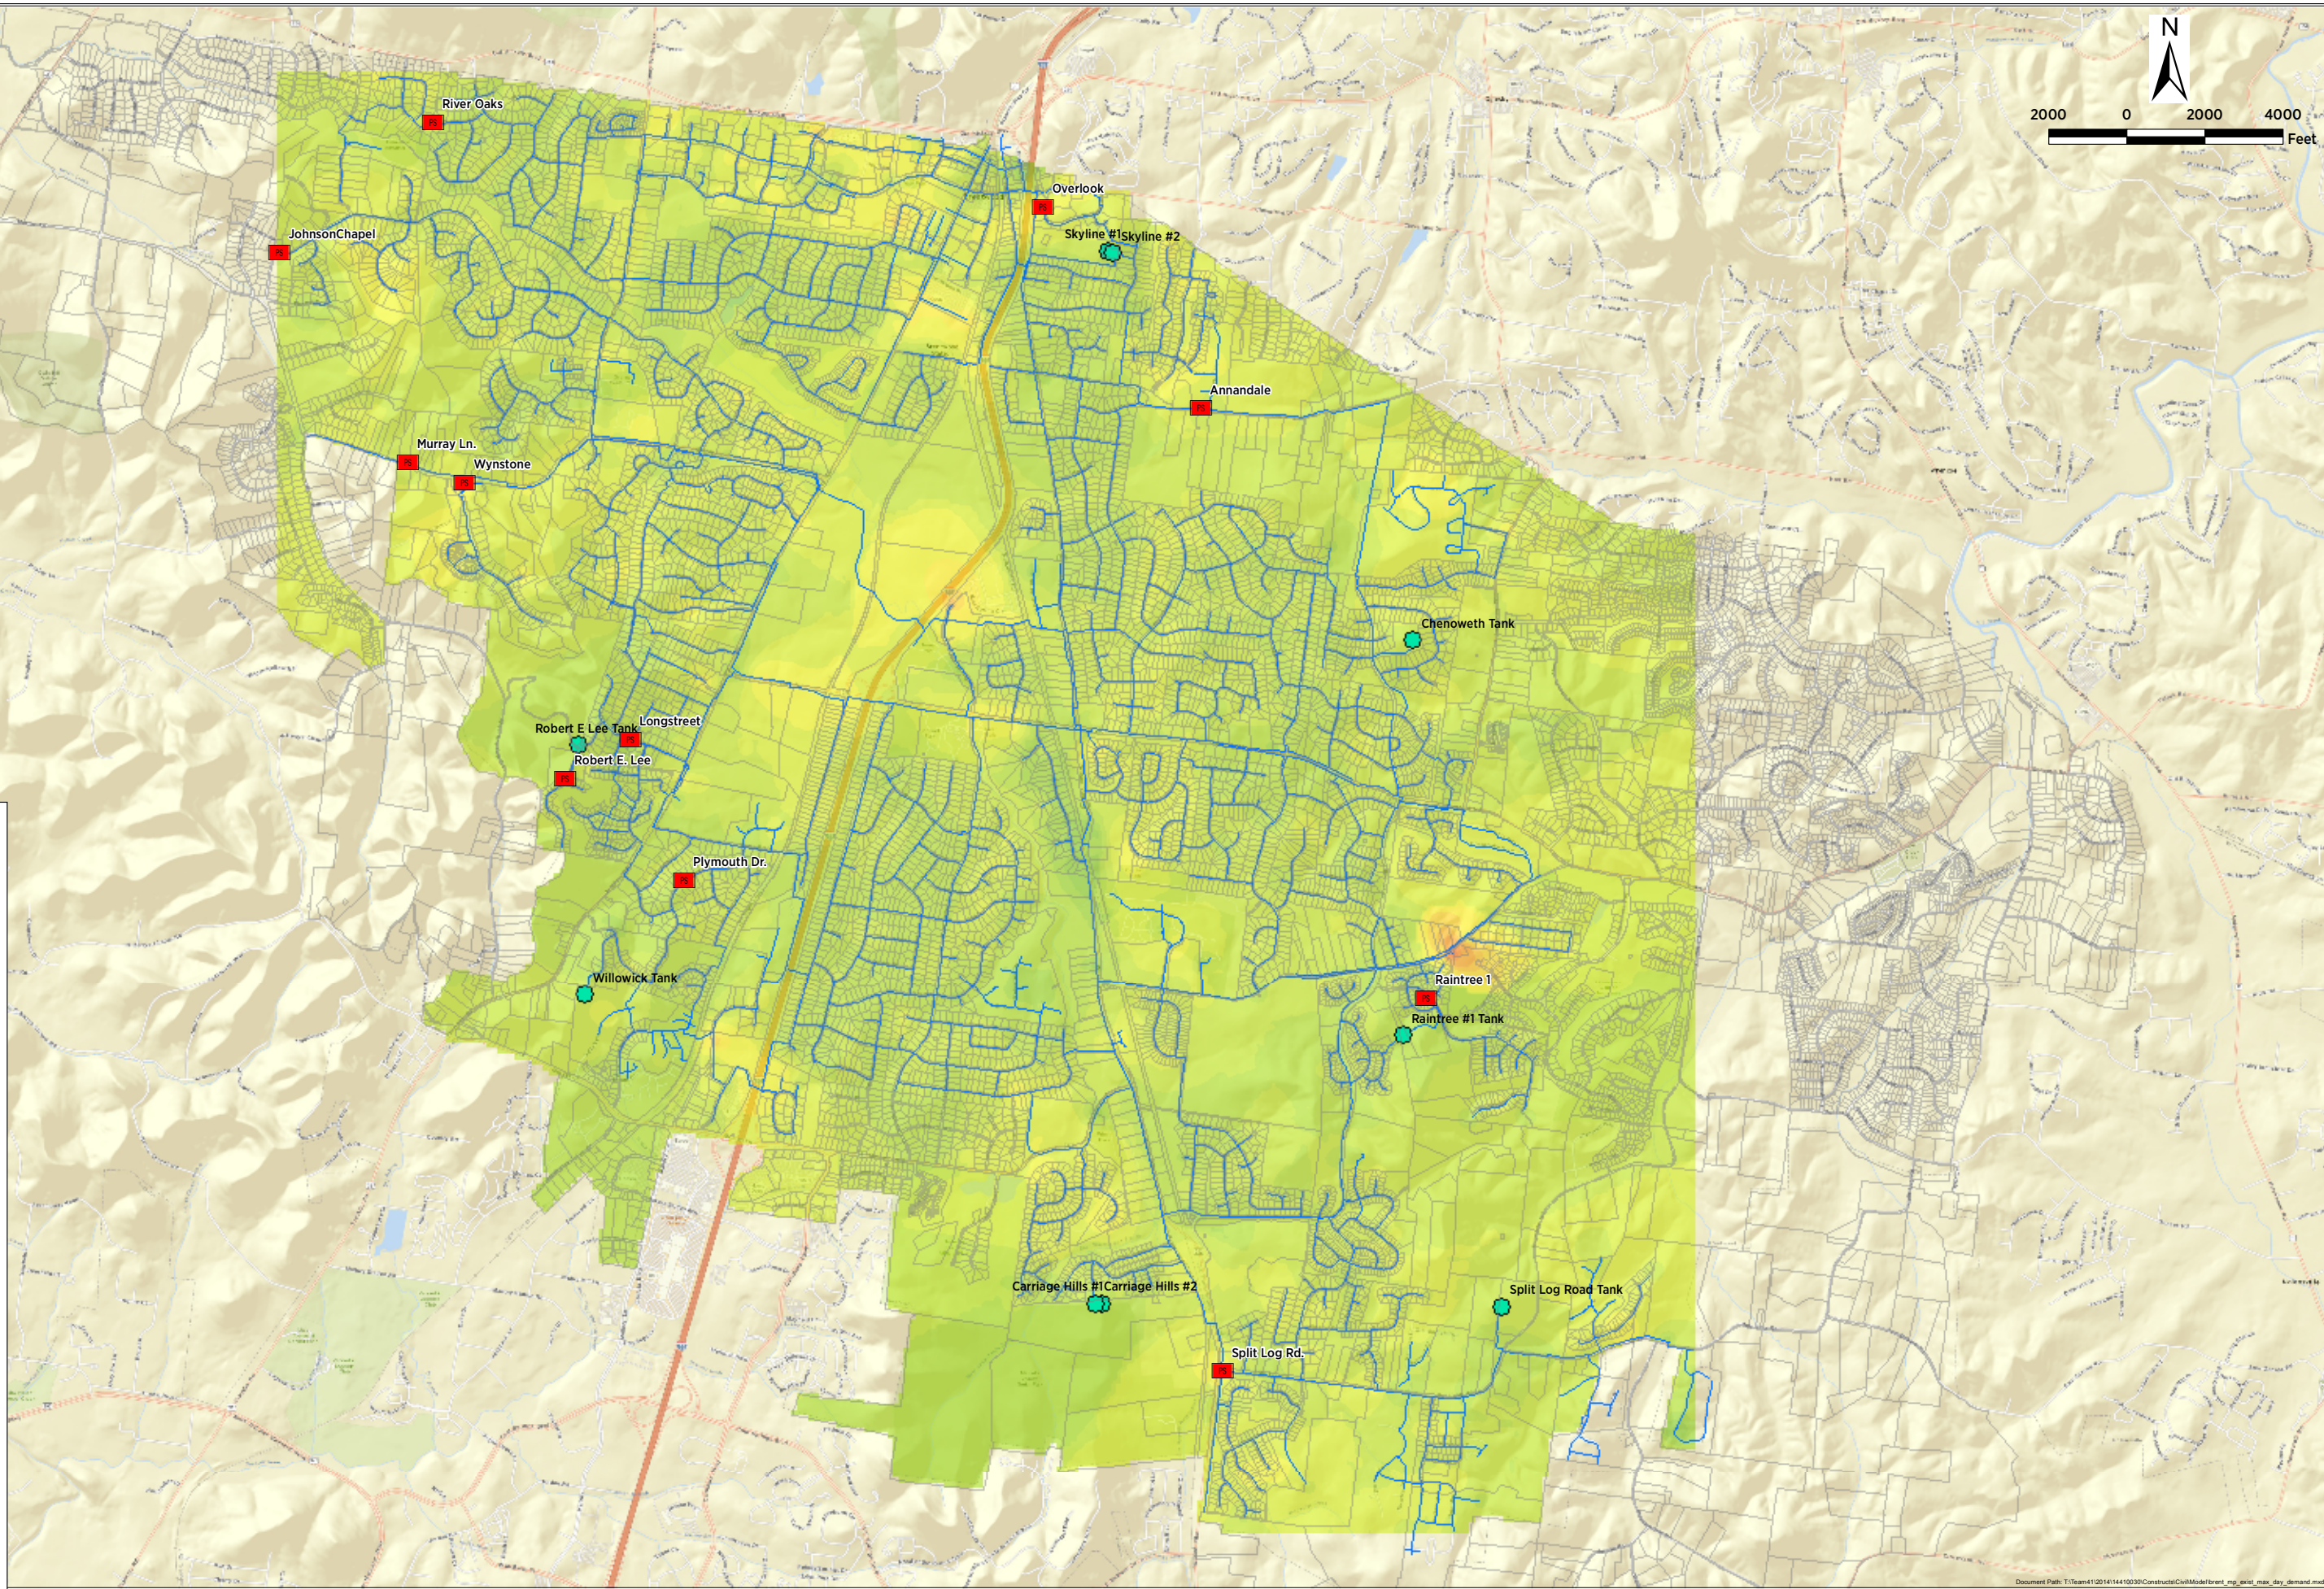

Existing Max. Demand

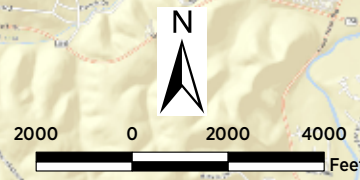

Legend
Short Term Max. Day Demand
Gallons per Day (gpd)

	< 50
	50 - 100
	101 - 500
	501 - 1,000
	1,001 - 2,500
	2,501 - 5,000
	5,001 - 10,000
	10,001 - 25,000
	25,001 - 50,000
	50,001 - 75,000
	75,001 - 100,000
	100,001 - 200,000
	200,001 - 300,000
	300,001 - 400,000
	400,001 - 500,000
	500,001 - 516,022 (Max.)

Water Line


Pump Stations

Clear Well


Reservoir

Water Tank

Parcels

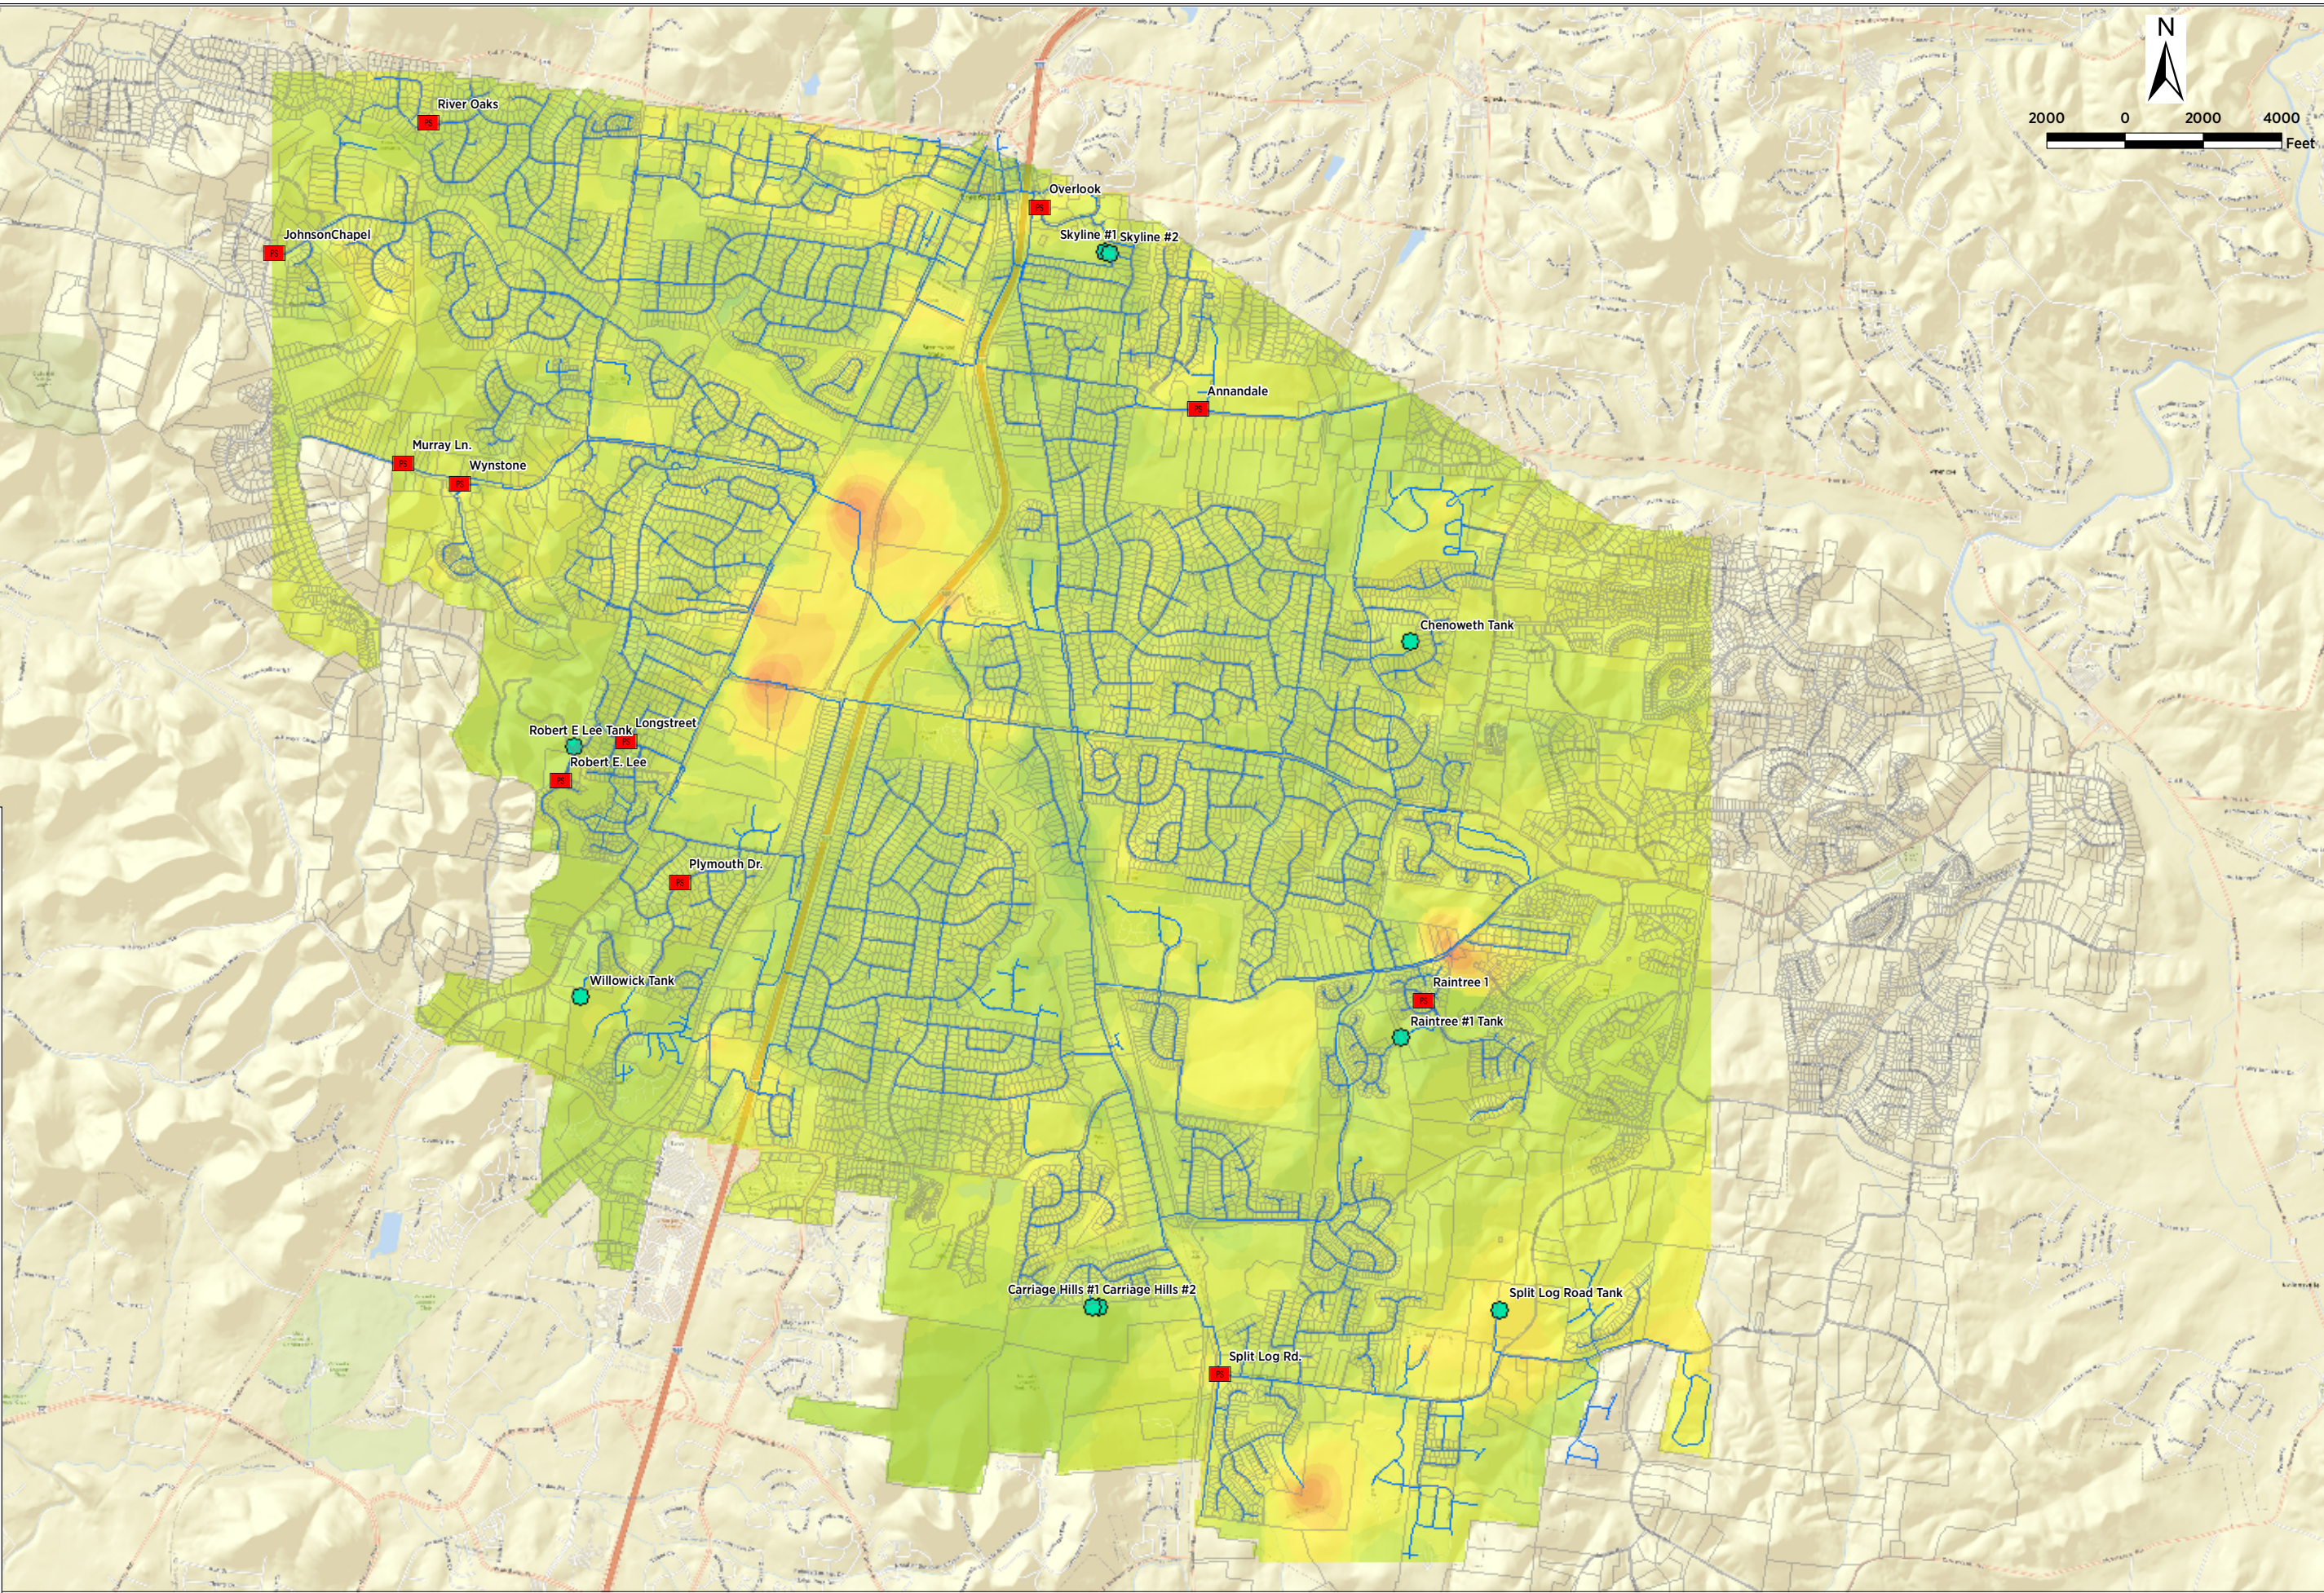

Short Term Max. Demand

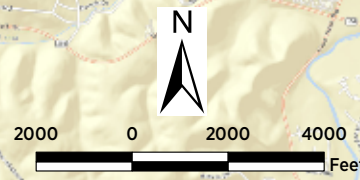

Legend

Long Term Max. Day Demand
Gallons per Day (gpd)

	< 50
	50 - 100
	101 - 500
	501 - 1,000
	1,001 - 2,500
	2,501 - 5,000
	5,001 - 10,000
	10,001 - 25,000
	25,001 - 50,000
	50,001 - 75,000
	75,001 - 100,000
	100,001 - 200,000
	200,001 - 300,000
	300,001 - 400,000
	400,001 - 500,000
	500,001 - 552,681 (Max.)

Water Line


Pump Stations

Clear Well

Reservoir

Water Tank

Parcels

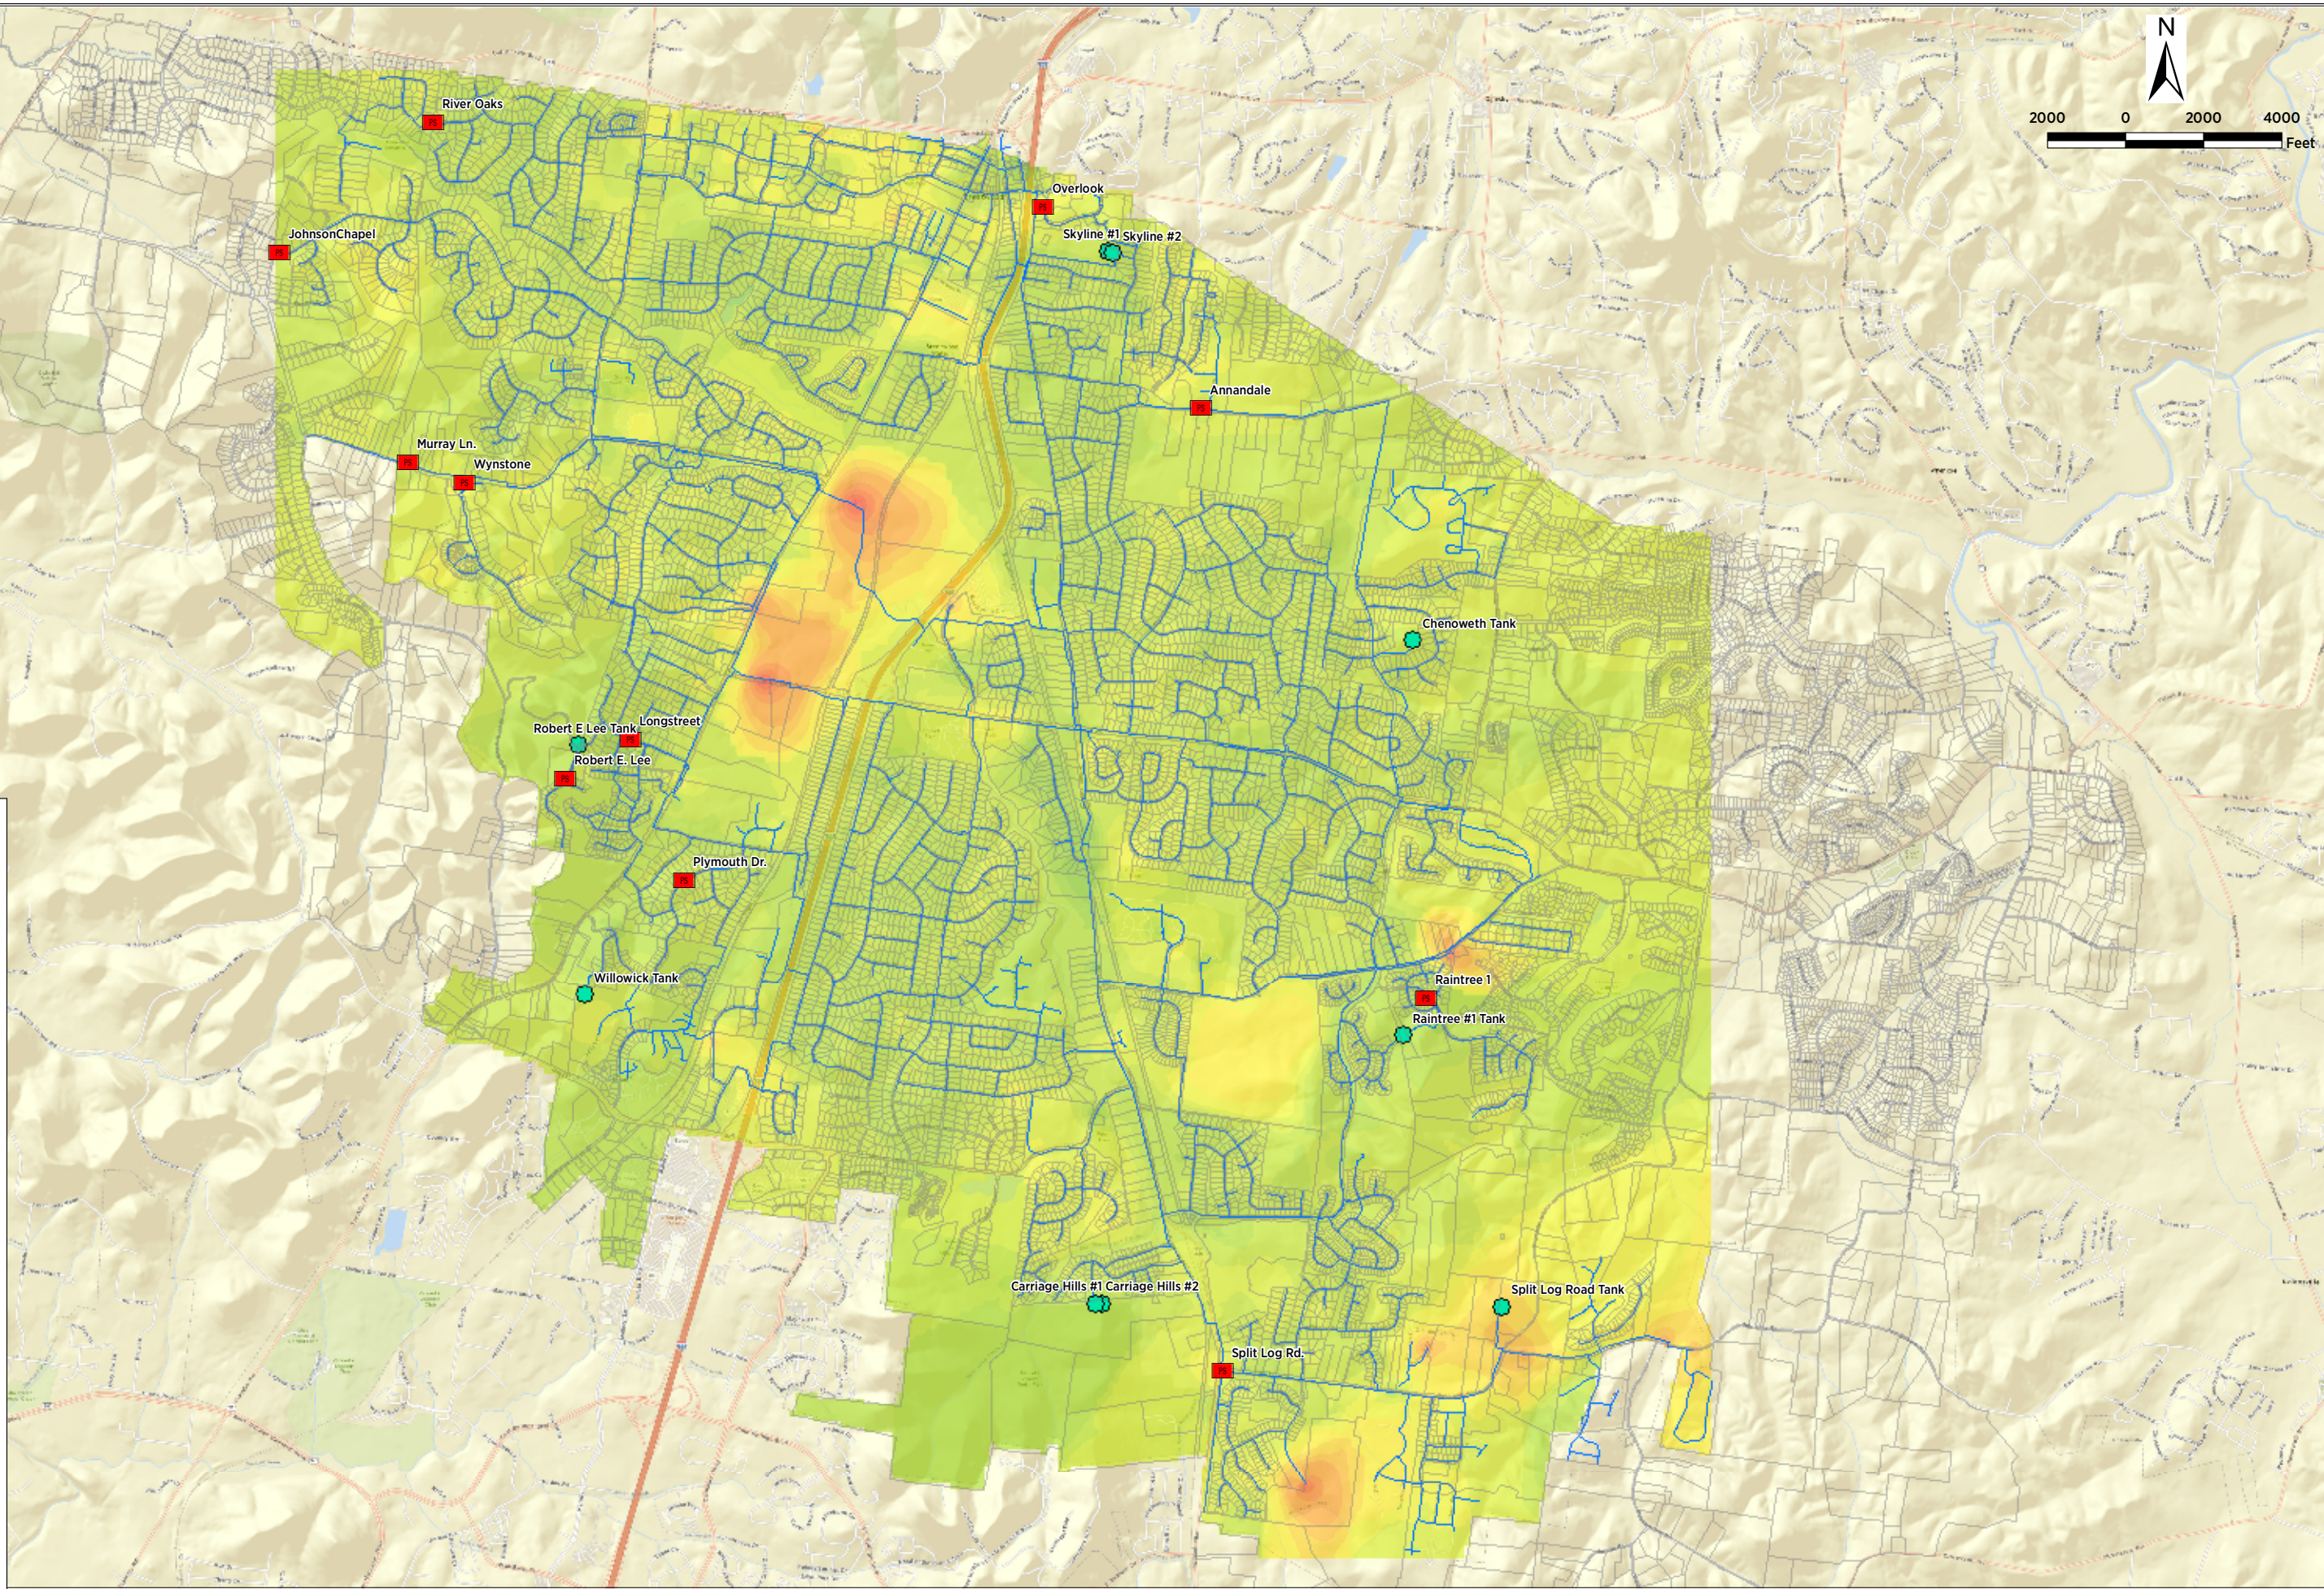

Long Term Max. Demand